

Easy! Smooth!

## Replacement Guidebook

GP-3400T

- > SP-5400WA (Advanced Display)
- + SP-5B10(Power Box)
- SP-5B00(Standard Box)

## Preface

This guidebook introduces the procedures to replace GP-3400T in below table with a SP-5400WA+SP-5B10/SP-5B00.

Model in use	Model No.	Recommended Substitution
GP-3400T	AGP3400-T1-D24	SP-5400WA (Advanced display) + SP-5B00(Standard Box) -> <a href="#">see 1.1</a>
GP-3400S	AGP3400-S1-D24	
GP-3400T (FLEXNETWORK type)	AGP3400-T1-D24-FN1M	SP-5400WA (Advanced display) + SP-5B10 (Power Box) + FLEXNETWORK unit (Model No. PFXZCHEUFN1) -> <a href="#">see 1.2</a>
GP-3400T/3400S (DIO type)	AGP3400-S1-D24-D81C AGP3400-S1-D24-D81K AGP3400-T1-D24-D81C AGP3400-T1-D24-D81K	
GP-3400S (CANopen type)	AGP3400-S1-D24-CA1M	SP-5400WA (Advanced display) + SP-5B10 (Power Box) + CANopen Master unit (Model No. PFXZCHEUCAM1) -> <a href="#">see 1.2</a>

'Display' and 'Box' of SP5000 series can be separated, so you can freely select a suitable combination of them according to use. This guidebook introduces specifications for a combination of SP-5400WA (Advanced Display) that is a 7-inch wide display module and SP-5B10 (Power box) or SP-5B00(Standard Box) that is a box module.



## Safety Information

### HAZARD OF OPERATOR INJURY, OR UNINTENDED EQUIPMENT DAMAGE

Before operating any of these products, be sure to read all related manuals thoroughly.

Failure to follow these instructions can result in death, serious injury or unintended equipment damage.



## Contents

<b><u>PREFACE</u></b>	<b><u>2</u></b>
<b><u>CHAPTER 1 SPECIFICATION COMPARISON</u></b>	<b><u>6</u></b>
1.1 SPECIFICATIONS OF GP-3400T (STANDARD CLASS) AND SP-5400WA+SP-5B00	6
1.2 SPECIFICATIONS OF GP-3400T (CONTROL CLASS) AND SP-5400WA+SP-5B10	8
<b><u>CHAPTER 2 COMPATIBILITY OF HARDWARE</u></b>	<b><u>11</u></b>
2.1 LOCATIONS OF CONNECTOR	11
2.2 USB TRANSFER CABLE.	13
2.3 INTERFACE	13
2.3.1 SERIAL INTERFACE	13
2.3.2 AUX INTERFACE	13
2.3.3 AUDIO OUTPUT INTERFACE	13
2.3.4 FLEXNETWORK INTERFACE, FLEXNETWORK INTERFACE, CANOPEN INTERFACE, DIO INTERFACE	14
2.3.5 CF CARD INTERFACE	14
2.4 PERIPHERAL UNITS AND OPTION UNITS	15
2.4.1 BARCODE/ 2D [TWO-DIMENSIONAL] CODE READER CONNECTION	15
2.4.2 PRINTER CONNECTION	15
2.4.3 EXPANSION UNIT	15
2.4.4 ISOLATION UNIT	16
2.5 BACKUP BATTERY	16
2.6 ABOUT LADDER MONITOR	17
2.7 ABOUT PRO-SERVER EX	17
2.8 DISPLAY RESOLUTION	17
2.9 PANEL CUTOUT DIMENSIONS AND EXTERNAL DIMENSIONS	17
2.10 OTHER NOTES	18
<b><u>CHAPTER 3 REPLACEMENT PROCEDURE</u></b>	<b><u>19</u></b>

<b>3.1 WORK FLOW</b>	<b>19</b>
<b>3.2 PREPARATION</b>	<b>20</b>
<b>3.3 RECEIVE SCREEN DATA FROM GP-3400T</b>	<b>21</b>
<b>3.4 CHANGE THE DISPLAY UNIT TYPE</b>	<b>26</b>
<b>3.5 TRANSFER THE SCREEN DATA TO SP5000 SERIES</b>	<b>27</b>
<b>3.6 DIFFERENCES OF SOFTWARE</b>	<b>31</b>
 <b><u>CHAPTER 4 COMMUNICATION WITH DEVICE/PLC</u></b>	 <b><u>32</u></b>
 <b>4.1 SHAPES AND COMMUNICATION METHOD OF COM PORTS</b>	 <b>32</b>
<b>4.2 SIGNALS OF COM 2 PORT</b>	<b>32</b>
<b>4.3 CABLE DIAGRAM AT THE TIME OF REPLACEMENT</b>	<b>33</b>
<b>4.4 MULTILINK CONNECTION</b>	<b>33</b>
 <b><u>CHAPTER 5 APPENDIX</u></b>	 <b><u>34</u></b>
 <b>5.1 CHANGING THE SETTING OF THE EXTERNAL MEDIA TO USE</b>	 <b>34</b>

## Chapter 1 Specification Comparison

### 1.1 Specifications of GP-3400T (Standard Class) and SP-5400WA+SP-5B00

		GP3000 series	SP5000 series
		 <p><b>GP-3400T</b></p>	 <p><b>SP-5400WA (Advanced Display)</b> + <b>SP-5B00 (Standard box)</b></p>
<b>Display Type</b>		TFT Color LCD	
<b>Display Colors</b>		65,536 colors (without blink) / 16,384 colors (with blink)	<b>UP!</b> 262,144 colors (without blink) *1
<b>Display Resolution</b>		VGA (640 × 480 pixels)	<b>UP!</b> WVGA (800 × 480 pixels) -> <a href="#">See 2.8</a>
<b>Panel Cutout Dimensions</b>		W204.5 × H159.5mm	<b>NEW!</b> W190 × H135mm-> <a href="#">see 2.9</a>
<b>External Dimensions</b>		W215.5 × H170 × D60mm	<b>NEW!</b> W203.6 × H148.6 × D67mm*2
<b>Touch Panel Type</b>		Resistive film (Analog)	
<b>Memory</b>	<b>Application</b>	16MB	<b>UP!</b> 64MB
	<b>SRAM</b>	SRAM: 320KB	<b>UP!</b> NVRAM: 320KB
<b>Backup Battery</b>		Secondary Battery (Rechargeable Lithium battery)	<b>UP!</b> - -> <a href="#">see 2.5</a>
<b>Input Voltage</b>		DC24V	<b>NEW!</b> DC 12 to 24V
<b>Serial I/F</b>	<b>COM1</b>	D-Sub9 pin (plug) RS-232C/422/485	D-Sub9 pin (plug) RS-232C
	<b>COM2</b>	D-Sub9 pin (socket) RS-422/485	<b>UP!</b> D-Sub9 pin (plug) RS-422/485 -> <a href="#">see 2.3.1</a> and <a href="#">Chapter4</a>
<b>Ethernet I/F</b>		1 port 10BASE-T/100BASE-TX	<b>UP!</b> 2 ports 10BASE-T/100BASE-TX
<b>CF Card I/F</b>		✓	- -> <a href="#">see 2.3.5</a>
<b>SD card I/F</b>		-	<b>NEW!</b> ✓ -> <a href="#">see 2.3.5</a>

<b>USB I/F</b>	<b>Type A</b>	1 port	<b>UP!</b> 2 ports -> <a href="#">see 2.4.1</a>
	<b>Type mini B</b>	-	<b>UP!</b> 1 ports -> <a href="#">see 2.4.1</a>
<b>Auxiliary I/O I/F</b>		✓	- *3
<b>Expansion Unit I/F</b>		✓	- *3
<b>FLEXNETWORK I/F</b>		✓ AGP3400-T1-D24-FN1M only	- *3
<b>CANopen I/F</b>		✓ AGP3400-S1-D24-CA1M only	- *3
<b>DIO I/F</b>		Input Sink/Source: 6 points Output Source: 2 points (AGP3400-S1-D24-D81*/ AGP3400-T1-D24-D81* only)	- *3
<b>Sound Output I/F</b>		Speaker Output:70mW(Rated Load:8Ω, Frequency:1kHz), Connector: 2-piece terminal block (AUX) x 1	- *3
<b>Software</b>		GP-Pro EX V2.00 or later*3	GP-Pro EX V4.08.200 or later



\*1: SP-5B00 does not support hardware 3<sup>rd</sup> speed blink.

\*2: Size for the time when SP-5400WA (Advanced display) is combined with SP-5B00 (Standard box).

\*3: If need this I/F, SP5B10(Power box) is required.

\*4 : GP-Pro EX V2.2 or later is required for hardware unit with Rev.4 or later.

## 1.2 Specifications of GP-3400T (Control Class) and SP-5400WA+SP-5B10

		GP3000 series	SP5000 series
		 <p><b>GP-3400T</b></p>	 <p><b>SP-5400WA</b> (Advanced Display) + <b>SP-5B10</b> (Power box)</p>
<b>Display Type</b>		TFT Color LCD	
<b>Display Colors</b>		65,536 colors (without blink) / 16,384 colors (with blink)	<b>UP!</b> 262,144 colors (without blink) / 65,536 colors (with blink)
<b>Display Resolution</b>		VGA (640 × 480 pixels)	<b>UP!</b> WVGA (800 × 480 pixels)*1 -> <a href="#">See 2.8</a>
<b>Panel Cutout Dimensions</b>		W204.5×H159.5mm	<b>NEW!</b> W190 x H135mm-> <a href="#">see 2.9</a>
<b>External Dimensions</b>		W215.5×H170×D60mm	<b>NEW!</b> W203.6 × H148.6 × D67mm*2
<b>Touch Panel Type</b>		Resistive film (Analog)	
<b>Memory</b>	<b>Application</b>	16MB	<b>UP!</b> 64MB
	<b>SRAM</b>	SRAM: 320KB	<b>UP!</b> NVRAM: 320KB
<b>Backup Battery</b>		Secondary Battery (Rechargeable Lithium battery)	<b>UP!</b> - -> <a href="#">see 2.5</a>
<b>Input Voltage</b>		DC24V	<b>NEW!</b> DC 12 to 24V
<b>Serial I/F</b>	<b>COM1</b>	D-Sub9 pin (plug) RS-232C/422/485	D-Sub9 pin (plug) RS-232C/422/485
	<b>COM2</b>	D-Sub9 pin (socket) RS-422/485	<b>UP!</b> D-Sub9 pin (plug) RS-232C/422/485 -> <a href="#">see 2.3.1</a> and <a href="#">Chapter4</a>
<b>Ethernet I/F</b>		1 port 10BASE-T/100BASE-TX	<b>UP!</b> 2 ports 10BASE-T/100BASE-TX/1000BASE-T
<b>CF Card I/F</b>		✓	- -> <a href="#">see 2.3.5</a>
<b>SD card I/F</b>		-	<b>NEW!</b> ✓ -> <a href="#">see 2.3.5</a>



<b>USB I/F</b>	<b>Type A</b>	1 port	<b>UP!</b> 2 ports -> <a href="#">see 2.4.1</a>
	<b>Type mini B</b>	-	<b>UP!</b> 1 ports -> <a href="#">see 2.4.1</a>
<b>Auxiliary I/O I/F</b>		✓	✓-> <a href="#">see 2.3.2</a>
<b>Expansion Unit I/F</b>		✓	✓ → <a href="#">see 2.4.3</a>
<b>FLEXNETWORK I/F</b>		✓ AGP3400-T1-D24-FN1M only	FLEXNETWORK unit (Model No. PFXZCHEUFN1) is required → <a href="#">see 2.3.4</a>
<b>CANopen I/F</b>		✓ AGP3400-S1-D24-CA1M only	CANopen Master unit (Model No. PFXZCHEUCAM1) is required → <a href="#">see 2.3.4</a>
<b>DIO I/F</b>		Input Sink/Source: 6 points Output Source: 2 points (AGP3400-S1-D24-D81*/AGP3400-T1-D24-D81* only)	FLEXNETWORK unit Is required → <a href="#">see 2.3.4</a>
<b>Sound Output I/F</b>		Speaker Output: 70mW (Rated Load: 8Ω, Frequency: 1kHz), Connector: 2-piece terminal block (AUX) x 1	<b>UP!</b> Speaker Output: 300mW or more (Rated Load: 8Ω, Frequency: 1kHz) LINE Output: 1.4Vp-p (Rated Load: 10kΩ) Connector: 2-piece terminal block (AUX) x 1 -> <a href="#">see 2.3.3</a>
<b>Software</b>		GP-Pro EX V2.00 or later*3	GP-Pro EX V4.02 or later

\*1: This resolution is supported from GP-Pro EX Ver.4.02 or later

\*2: Size for the time when SP-5400WA (Advanced display) is combined with SP-5B10 (Power box).

For further use of expansion communication unit, please refer to below FAQ.

PROFIBUS DP SLAVE/MPI unit (Model No.: PFXZCDEUPF1)

[https://www.proface.com/en/support/faq?page=content&country=PROFACE&lang=en&locale=en\\_US&id=FA315627&prd=&redirect=true](https://www.proface.com/en/support/faq?page=content&country=PROFACE&lang=en&locale=en_US&id=FA315627&prd=&redirect=true)

FLEXNETWORK unit (Model No. PFXZCHEUFN1)

[https://www.proface.com/en/support/faq?page=content&country=PROFACE&lang=en&locale=en\\_US&id=FA330215&prd=&redirect=true](https://www.proface.com/en/support/faq?page=content&country=PROFACE&lang=en&locale=en_US&id=FA330215&prd=&redirect=true)

CANopen Master Unit (Model No: PFXZCHEUCAM1)

[https://www.proface.com/en/support/faq?page=content&country=PROFACE&lang=en&locale=en\\_US&id=FA315627&prd=&redirect=true](https://www.proface.com/en/support/faq?page=content&country=PROFACE&lang=en&locale=en_US&id=FA315627&prd=&redirect=true)

[ng=en&locale=en\\_US&id=FA326702&prd=&redirect=true](#)


\*3 : GP-Pro EX V2.2 or later is required for hardware unit with Rev.4 or later.

# Chapter 2 Compatibility of Hardware


## 2.1 Locations of connector

Connector locations on GP-3400T and SP5000 are as follows:


### GP-3400T

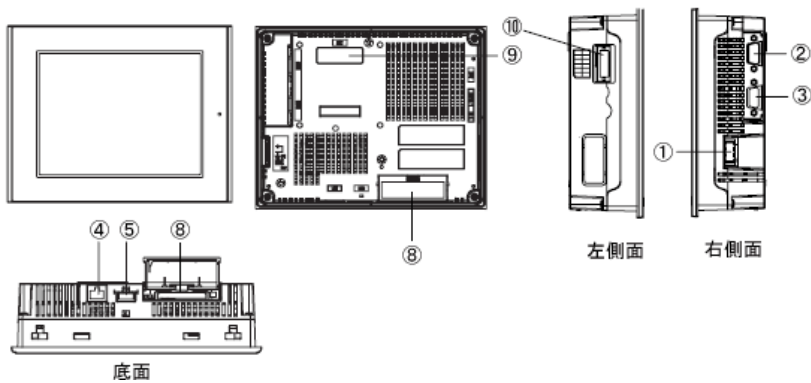


### SP-5400WA(Advanced Display)

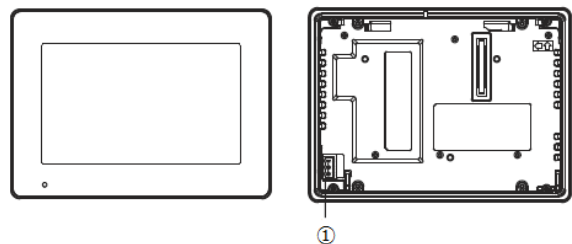

### SP-5B10(Power box)

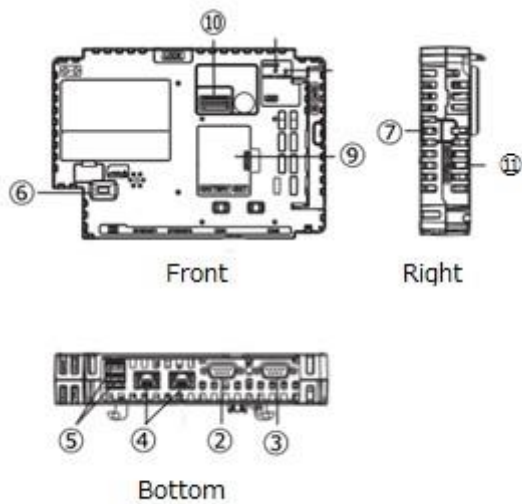

### SP-5B00(Standard Box)

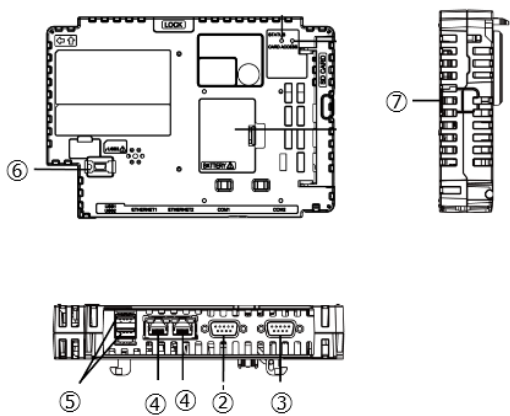



Interface names

	<b>GP-3400T</b>	<b>SP-5400WA</b> (Advanced Display) <b>+ SP-5B10 (Power box)</b>	<b>SP-5400WA</b> (Advanced Display) <b>+ SP-5B00 (Standard box)</b>
1	Power Connector (DC)		Power Connector (DC)
2	Serial I/F (COM1)		
3	Serial I/F (COM2)		
4	Ethernet I/F		
5	USB I/F (Type A)		
6	-	USB I/F (Type mini B)	
7	-	Storage Card Cover (There's a SD card I/F for storage under the cover.)	
8	CF card I/F	-	-
9	Expansion Unit I/F (Communication Unit)		-
10	Auxiliary I/O / Sound Output I/F (AUX)		-
11	-	System Card Cover (There's a SD card I/F for the system under the cover.)	-

## 2.2 USB Transfer cable.

Like the GP3000 series, a USB transfer cable (CA3-USBCB-01) can be used for the SP5000 series. Also, a USB (Type mini B) cable (ZC9USCBMB1) and commercial cables can be used on the SP5000 series' side.

	Model	Connector Type	Connector on Display
Options	CA3-USBCB-01		USB (Type A)
	ZC9USCBMB1		USB (Type mini B)
Commercial Item	-		

## 2.3 Interface

### 2.3.1 Serial Interface

The SP5000 series has a COM port on the side of box module.

The pin array and the shapes of the plug and the socket differ between GP-3400T COM2 port and SP-5B10 (Power box)/SP-5B00(Standard Box) COM port. The PLC connection cable that used to be connected to GP-3400T via its COM2 port cannot be used as it is. For details, refer to "[Chapter 4 Communication with Device/PLC](#)". Cables other than that can be used as they are.

When both the COM1 port and the COM2 port have the RS-422/485 setting, only the COM2 port can be used for RS433/485 connection after replacement to SP-5B00(Standard Box)

### 2.3.2 AUX Interface

SP-5B10 (Power Box) has AUX interface, but it has only 1 output for alarm and buzzer. (Alarm and buzzer output is changeable with GP-Pro EX). Please note that RUN output and External reset input is not supported.

### 2.3.3 Audio Output Interface

If sound output is needed, select SP-5B10(Power Box) and use AUX I/F.

When using Speaker Output, the output value has increased from 70mW to 300mW, so customers using an amplifier should be aware of it.

### 2.3.4 FLEXNETWORK interface, FLEXNETWORK interface, CANOpen interface, DIO interface

When GP3000 series (C Class) DIO model, FLEXNETWORK model and CANOpen model was used, SP-5B10 (Power BOX) is required.

For SP5000 series, below module is required.

GP3000 series (Control model)		Expansion unit for SP5000 series
FLEXNETWORK type	AGP3400-T1-AF-FN1M AGP3400-T1-D24-FN1M	FLEXNETWORK unit (Model number: PFXZCHEUFN1) For more details, please refer <a href="#">FAQ:FA330215</a>
CANopen type	AGP3400-S1-AF-CA1M AGP3400-S1-D24-CA1M	CANopen master unit (Model number: PFXZCHEUCAM1) For more details, please refer <a href="#">FAQ:FA326702</a>
DIO type	AGP3400-S1-D24-D81C AGP3400-S1-D24-D81K AGP3400-T1-D24-D81C AGP3400-T1-D24-D81K	FLEXNETWORK unit (Model number: PFXZCHEUFN1) and FLEXNETWORK I/O unit (Model number: FN-XY16S*41) For more details, please refer <a href="#">FAQ:FA335756</a>

SP-5B00 (Standard Box) cannot be used for expansion unit.

### 2.3.5 CF Card Interface

SP5000 series is not equipped with a CF card slot. But a SD card slot and a USB interfaces are installed. In order to use the GP-3400T's data saved in the CF card and the functions using the CF card, use a SD card or a USB flash drive instead.

SP-5B10 (Power box) has 2 SD card interfaces, one for the system and the other for backup. Use the interface of the SD card for backup.

\* When using a SD card with SP-5B10 (Power box), please verify it supports the following specifications:

	File format	Maximum capacity
SD	FAT16	2GB
SDHC	FAT32	32GB

When the setting of the output destination folder is set to "CF Card" on GP-Pro EX, if you change the display unit type, the setting will automatically change to the one that uses a SD card.

To change the setting of the output destination folder, see [[5.1 Changing the setting of the external media to use](#)].

## 2.4 Peripheral units and option units

### 2.4.1 Barcode/ 2D [two-dimensional] code reader connection

Like GP3000 series, SP5000 series allows you to connect a barcode reader to its USB interface (Type A) or its serial interface. In replacing GP3000 series with SP5000 series, verify proper operation of the barcode/2D code reader before use.

### 2.4.2 Printer connection

Like GP3000 series, SP5000 series allows you to connect a printer on its USB interface (Type A). In replacing GP3000 series with SP5000 series, verify proper operation of the printer before use.

### 2.4.3 Expansion Unit

If you used PROFIBUS unit for GP3000 series, SP-5B10 (Power Box) is required for the replacement.

If you used PROFIBUS unit for GP3000 series (model:CA5-PFSALL/EX-01), please apply PROFIBUS DP Slave (model no.: PFXZCDEUPF1) for SP-5B10(Power box).

Reference:

[FA315627] Replacement for GP3000 series PROFIBUS unit (Model no.: CA5-PFSALL/EX-01)

[https://www.proface.com/en/support/faq?page=content&country=PROFACE&lang=en&locale=en\\_US&id=FA315627&prd=&redirect=true](https://www.proface.com/en/support/faq?page=content&country=PROFACE&lang=en&locale=en_US&id=FA315627&prd=&redirect=true)

SP5000 Series Option List

(<https://www.proface.com/en/product/hmi/sp5000/option>)

The expansion unit (each kind of unit like CC-LINK Unit, VM unit) for GP3000 series cannot be used for SP5000 series.

#### 2.4.4 Isolation Unit


RS-485 isolation unit for GP3000 series (CA3-ISO485-01) cannot be used for SP-5B10 (Power box)/SP-5B00(Standard box). You can use the RS-232C isolation unit (CA3-ISO232-01) for SP-5B10 (Power box)/SP-5B00(Standard box) instead. (The communication method is switched with this unit's DIP switch.)

##### Note for using RS-232C isolation unit (CA3-ISO232-01)

- Connect it to SP5000 series via COM1 (232C) .
- In the case of RS-232C, it's necessary to set the 9<sup>th</sup> pin of the COM port to VCC.

[Settings on GP-ProEX]

Select "VCC" from [System Settings] -> [Device/PLC] in the [Project] menu on GP-Pro EX.

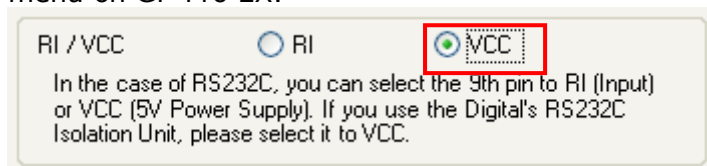

- RS-422/485 (2-wire type) communication and serial multilink are not supported.

#### 2.5 Backup Battery

SP-5B10/SP-5B00 is not needed a backup battery for Clock.

Supercapacitor (electric double-layer capacitor) can be back up clock data.

Please note the following points,

- When the voltage from the Supercapacitor is low, clock data is lost when this product is turned OFF. In order to charge up the super capacitor, power needs to be supplied to the main unit for 5 minutes or longer.
- The average period for backup is as follows:

Initial: Approximately 100 days

After 5 years: Approximately 30 days (used at ambient temperature of 25 °C [77 °F])

By connecting the Battery for Memory Backup (Model Number PFXZCBBT1) accessory, you can set up a backup period of up to 10 years or more.



## 2.6 About Ladder monitor

PLC Ladder monitor tool cannot be used for SP5000 series.

## 2.7 About Pro-Server EX


Use Pro-Server EX Ver.1.33 or later. For more detail, please refer to the following.

([http://www.proface.co.jp/otasuke/qa/server\\_ex/replace/](http://www.proface.co.jp/otasuke/qa/server_ex/replace/))


If using SP-5B00(Standard BOX), use Pro-Server EX Ver.1.36 or later.

## 2.8 Display Resolution

You can select resolution of SP-5400WA (Advanced Display) with GP-Pro EX [Change Display Unit] menu. Please set Display Module as SP-5400WA (WVGA 800x480 pixels).

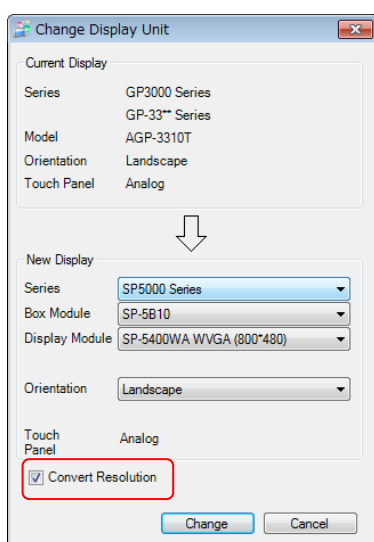

If you check on [Convert Resolution] when changing the Display Unit type (as shown below), you can adjust both size and location of the part and the text relative to the display resolution automatically. But please note that their width gets larger due to change of horizontal resolution of the screen area. In this case, confirm their size and location and adjust them if necessary.

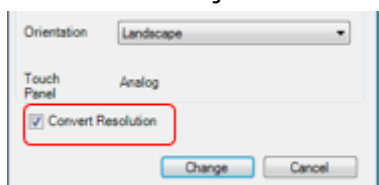

Especially, if using Standard font for the font type, after resolution converter, the size will get smaller.

In that case, you can improve by using stroke font or image font.

## 2.9 Panel Cutout Dimensions and External Dimensions

For replacing GP-3400T with SP-5400WA, the panel cutout dimensions and External Dimensions get smaller. It's necessary to change the panel cut size


.

## 2.10 Other Notes

- Do not expose SP5000 series to direct sunlight.
- Do not use SP5000 series outdoors.
- Do not turn on SP5000 series if condensation has occurred inside the device.
- When you are continuously using SP5000 series without oxygen, the brightness might decrease. Please ventilate the control panel periodically.

## Chapter 3 Replacement Procedure

### 3.1 Work Flow

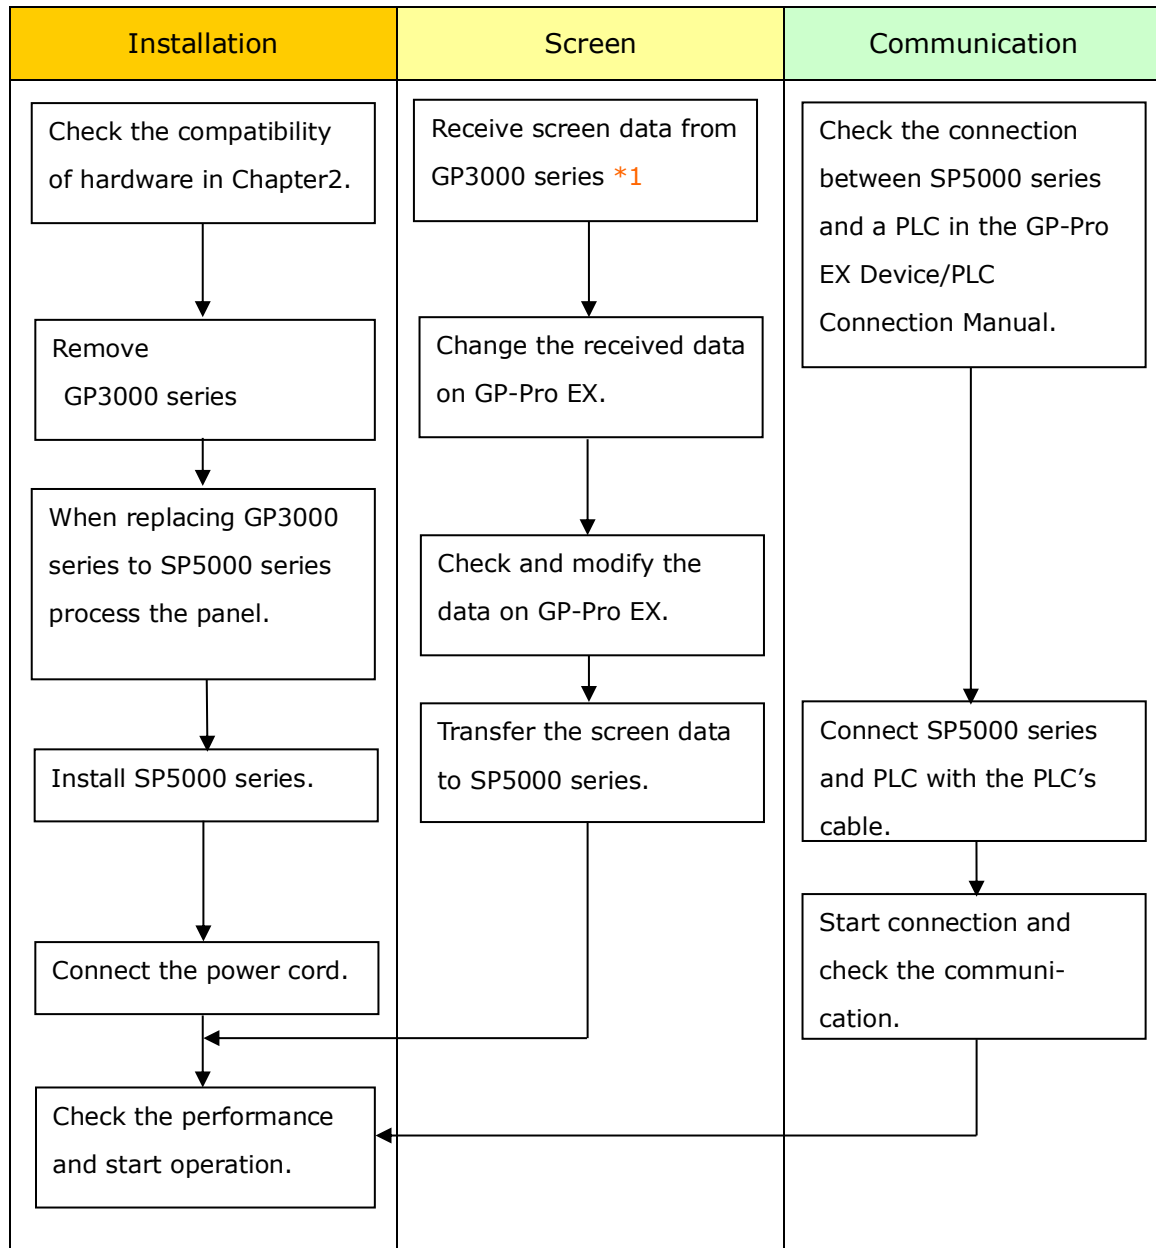

\*1: This step is required if screen data is saved only in the GP unit, not in any other device.

### 3.2 Preparation

Requirements for receiving screen data from GP-3400T *1	PC in which GP-Pro EX Transfer Tool is installed. *2
	USB Transfer Cable (model: CA3-USBCB-01) * Possible to send/receive a screen via a CF card, a USB storage device or Ethernet.
Requirements for converting screen data of GP-3400T and transferring the converted data to SP5000 series.	PC with GP-Pro EX installed. *Ver4.02 or later is required for SP-5B10*3 *Ver4.08.200 or later is required for SP-5B00
	Transfer Cable (The following three types of cables are available) <ul style="list-style-type: none"> <li>• A USB transfer cable (model: CA3-USBCB-01)</li> <li>• A USB data-transfer cable (model: ZC9USCBMB1)</li> <li>• A commercial USB cable (USB Type A/mini B)</li> </ul> * Possible to send/receive a screen via a SD card , a USB storage device or Ethernet.

\*1: This step is required if screen data is saved only in the GP unit, not in any other device.

\*2: Please use the same version or later as or than that of the software used during creating screens on GP3000 series. If you don't know the version, we recommend you to use the newest version. For the newest version, you can download the transfer tool from our web site called [OtasukePro!] ([http://www.pro-face.com/otasuke/download/freesoft/gpproex\\_transfer.htm](http://www.pro-face.com/otasuke/download/freesoft/gpproex_transfer.htm)) .

\*3 PROFIBUS DP slave/MPI unit (Model number: PFXZCDEUPF1) of SP5000 series is supported at GP-Pro EX V4.07.000 or later. Also FLEXNETWORK unit (Model number: PFXZCHEUFN1), CANopen Master unit (Model number: PFXZCHEUCAM1) is supported at GP-Pro EX V4.07.200 or later

### 3.3 Receive screen data from GP-3400T

You can transfer data from GP3000 series via;

- A USB transfer cable (model: CA3-USBCB-01)
- A CF card/USB storage device
- Ethernet

But this section explains, as an example, how to receive screen data from GP-3400T using a USB transfer cable (model: CA3-USBCB-01) .



(1) Connect your PC and GP-3400T with a USB transfer cable.


If the driver of the cable has not been installed on your PC yet, a dialog box will appear. Please follow the instructions.

#### NOTE


- The "Hardware Installation" dialog box as shown below may appear during installing the USB driver depending on the security level of Windows®. Click [Continue Anyway] to start installing the driver. When installation is completed, click [Finish].




Start the Transfer Tool of GP-Pro EX.

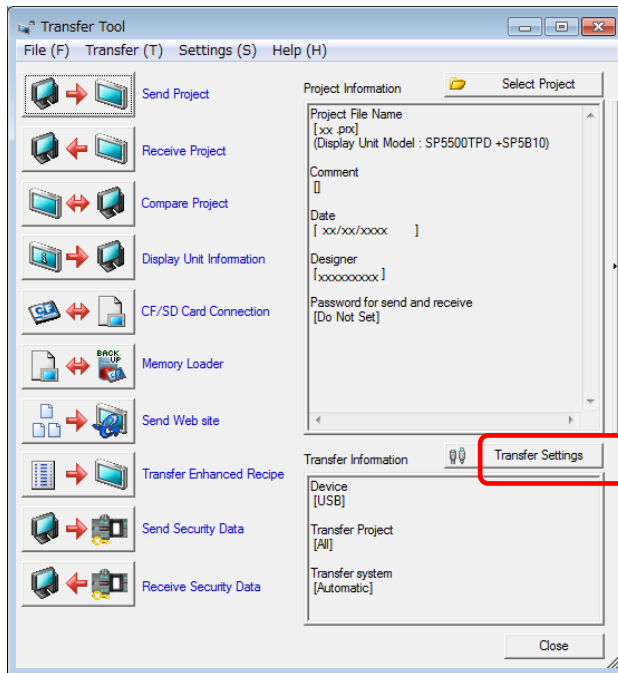


- (2) Make sure that the [Device] in the "Transfer Settings Information" is set to [USB]. If not, click the [Transfer Setting] button to open the "Transfer Setting" dialog box. Select [USB] in the Communication Port Settings field and click [OK].

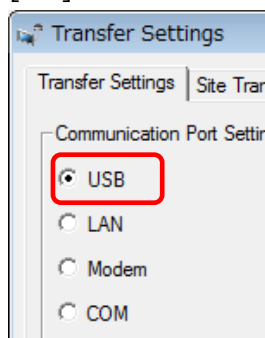

- (3) Start GP-Pro EX Transfer Tool and click the [Receive Project] button.

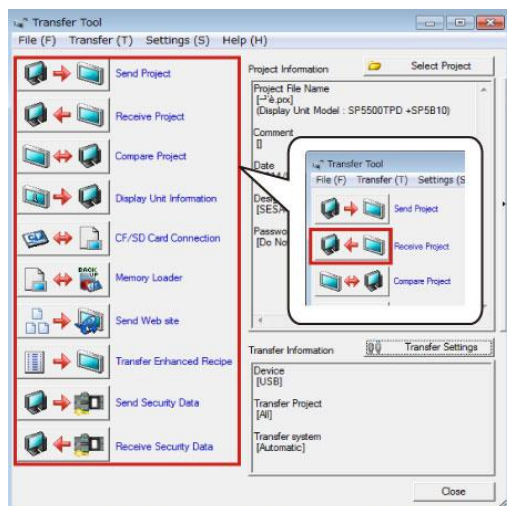


- (4) Click [Receive Project], and the following dialog box will appear. Specify a place to save the received data in and a project file name, and then click [Save] to start transfer.


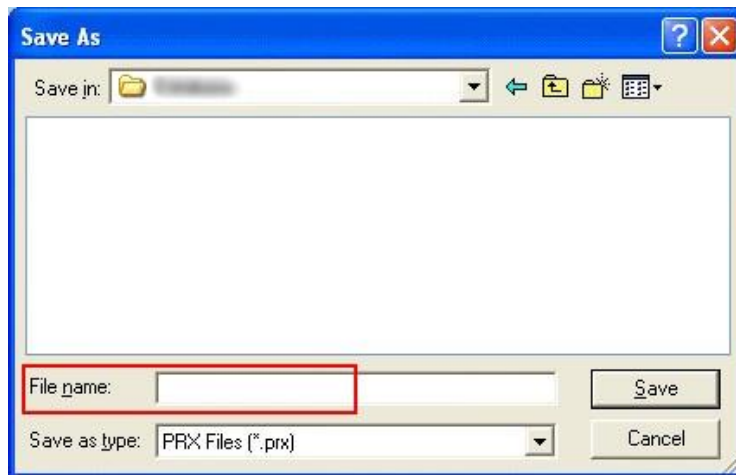


#### NOTE

When a file exists, the window that confirms whether or not to overwrite the file is displayed.

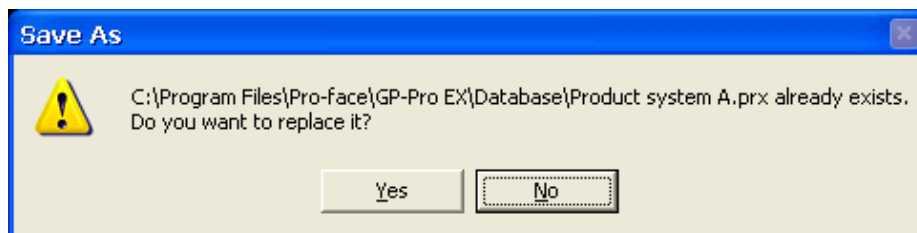

- (5) The following dialog box appears during transfer and you can check the communication status. (The display unit enters the Transferring mode and communication with the device such as a PLC is terminated.)

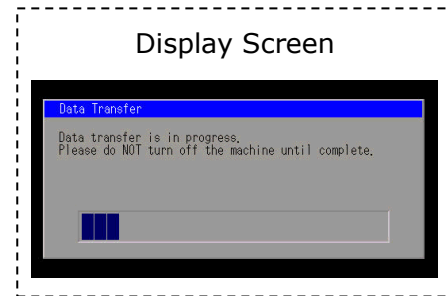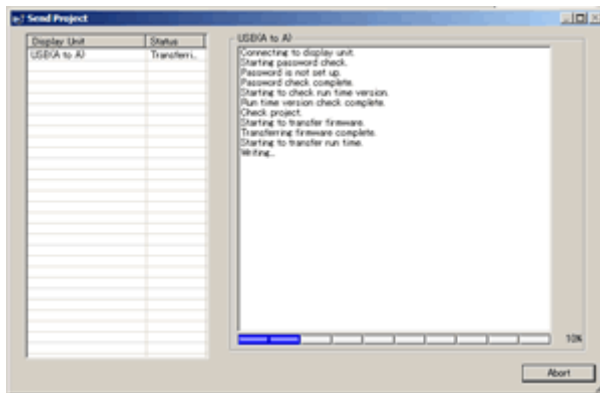

## NOTE

- If you receive the project files that use CF card data such as Recipe Function (CSV data), the following dialog box will appear during transfer. Specify a place to save the CF card data in. Click [OK], and the [Receive Project] dialog box will return and transfer will be completed.



- SP5000 series that is a replacement model is not equipped with a CF card slot. If the display unit type is changed to SP5000 series, the CF card setting will be replaced with the SD card setting automatically. To check or change the destination folder setting, see [[5.1 Changing the setting of the external media to use](#)].





### 3.4 Change the Display Unit Type

Open the received project file (\*.prx) of GP3000 series on GP-Pro EX and change the display unit type to SP5000 series.

- (1) Open the received project file (\*.prx) on GP-Pro EX.
- (2) Click [System Settings]->[Display]->[Change Display] in [Project] menu and change the Display Unit type to the replacement model.

#### Note

When changing the Display Unit type,

#### If you check on [Convert Resolution]:


Horizontal width of the part and the text relative to the display resolution becomes 1.25 times larger.

#### If you uncheck [Convert Resolution]:

(\* This is the default setting.)

Size of the part and the text relative to the display resolution doesn't change but the empty space (80 pixels) appears on both right and left side of the screen area.

After changing the Display Unit type, confirm size and location of the part/text and edit the screens if necessary.

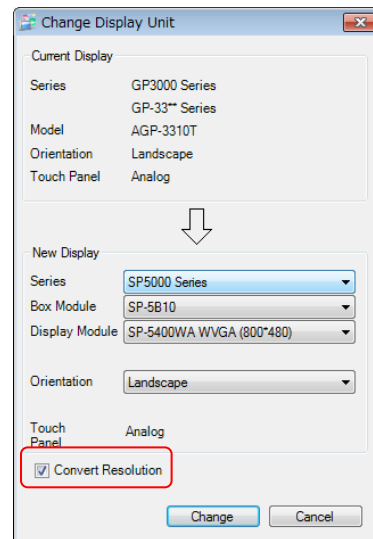

- (3) Click [Project]->[Save As] and save the changed project file.

### 3.5 Transfer the screen data to SP5000 series

Transfer the project file after the display unit type change to SP5000 series.

You can transfer data to SP5000 series via;

- An USB transfer cable (model: CA3-USBCB-01)
- An USB data transfer cable (model: ZC9USCBMB1)
- A commercial USB cable (USB Type A/mini B)
- A SD card/USB storage device
- Ethernet

But, this section explains, as an example, how to transfer screen data with an USB transfer cable (model: CA3-USBCB-01) .



- (1) Connect your PC and the GP unit of SP5000 series with a USB transfer cable. If the driver of the cable has not been installed on your PC, a dialog box will appear. Please follow the instructions.


#### NOTE

- The “Hardware Installation” dialog box as shown below may appear during installing the USB driver depending on the security level of Windows®.


Click [Continue Anyway] to start installing the driver. When installation is completed, click [Finish].



- (2) Turn on the power of SP5000 series. The “Initial Start Mode” screen will appear on the display unit. After transferring a project file once, this screen will not appear again.

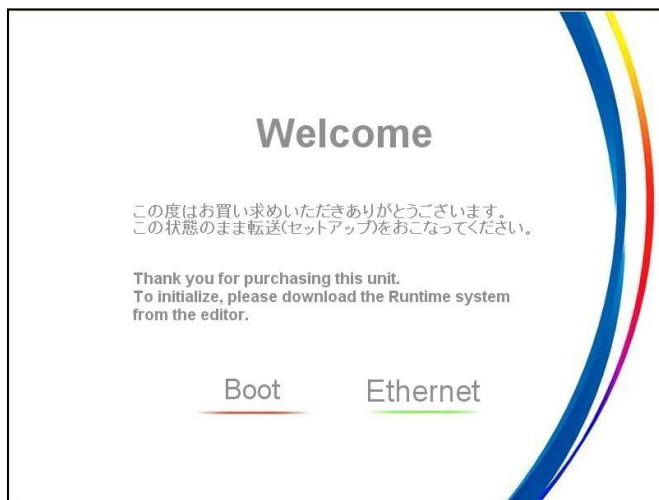


(3) On the GP-Pro EX's State Toolbar, click the [Transfer Project] icon to open the Transfer Tool.

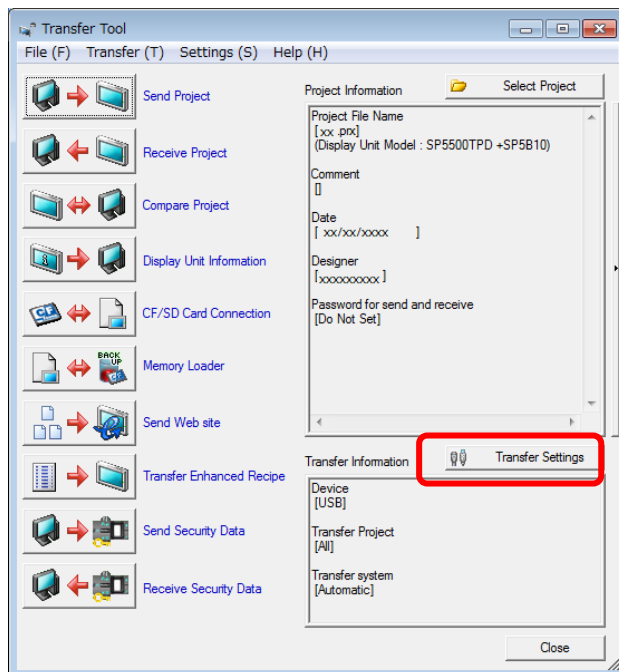

To transfer a different project file, click the [Select Project] button and select a project file.

- (4) Make sure that the [Device] in the "Transfer Settings Information" is set to [USB]. If not, click the [Transfer Setting] button to open the "Transfer Setting" dialog box. Select [USB] in the Communication Port Settings field and click [OK].


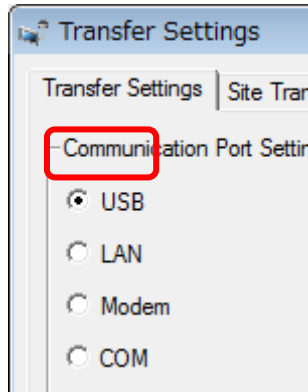


- (5) Click [Send Project] to start transfer.


When the following dialog box appears, click [Yes]. This dialog box doesn't appear when the same project file is sent again.



- (6) The following dialog box appears during transfer and you can check the communication status. (The display unit enters the Transferring mode and communication with the device such as a PLC is terminated.)

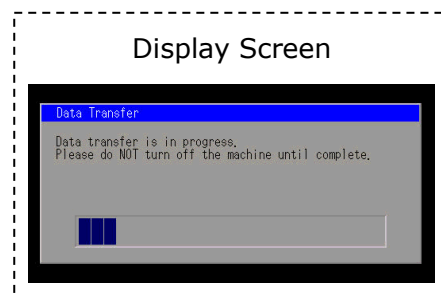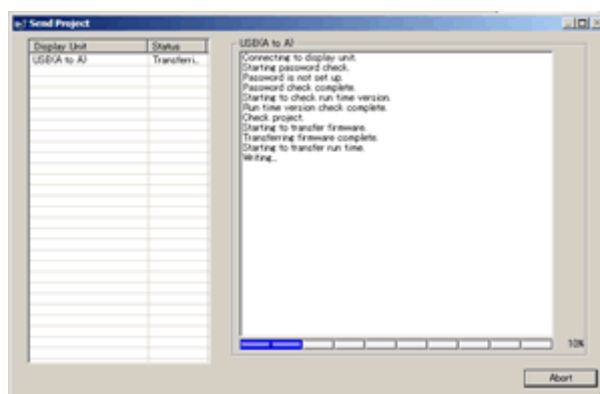

- (7) When transfer is completed, the status displayed in the dialog box will change from [Transferring] to [Complete Transfer]. Click [Close] to close the dialog box.

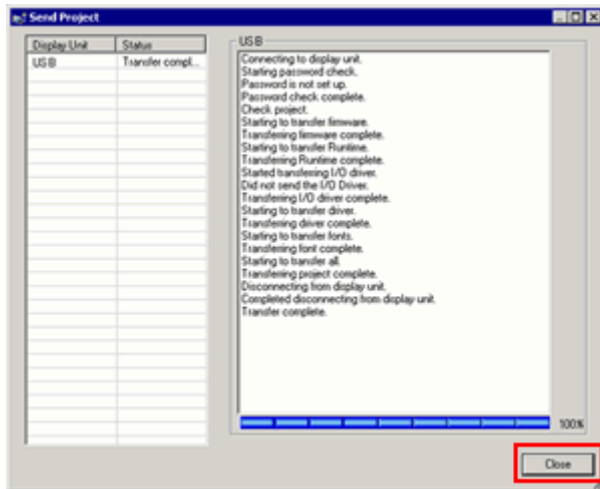

The display unit will be reset and a screen of the transferred project file will be displayed.

- (8) Close the Transfer Tool.  
(9) Click the [X] mark on top right of the screen or [Project]->[Exit] to close GP-Pro EX.

### 3.6 Differences of software

Some functions supported by GP-3400T are not supported by SP5000 series. For details of the supported parts and functions, refer to [Supported Features] of GP-Pro EX Reference Manual

(<http://www.pro-face.com/otasuke/files/manual/gpproex/new/refer/gpproex.htm>) .

## Chapter 4 Communication with Device/PLC


### 4.1 Shapes and Communication method of COM ports

	GP-3400T	SP-5B10 (Power box)	SP-5B00 (Standard box)
COM1	D-Sub9 (plug) RS-232C/422/485		D-sub9 (Plug) RS232C
COM2	D-Sub9 (socket) RS-422/485	D-Sub9 (plug) RS-232C/422/485	D-Sub9 (Plug) RS-422/485

When both the COM1 port and the COM2 port have the RS-422/485 setting, RS-422/485 cannot be used for COM1 with SP-5B00(Standard Box). In this case, replacement to SP-5B10(Power box) is required.

### 4.2 Signals of COM 2 port

At the time of RS-422/485 communication, the signal and the pin array differ between the COM2 port on GP-3400T and the COM2 port on SP5000 series (Power box/Standard box).

Pin Arrange ment	Pin No.	GP-3300T GP-3310T GP-3360T			SP-5B10(Power box)/ SP-5B00(Standard box)		
		Signal Name	Direction	Meaning	Signal Name	Direction	Meaning
	1	TRMRX	-	Termination (Receive side:100Ω)	RDA	Input	Receive Data A (+)
	2	RDA	Input	Receive Data A (+)	RDB	Input	Receive Data B (-)
	3	SDA	Output	Send Data A (+)	SDA	Output	Send Data A (+)
	4	RS (RTS)	Output	Request for Send	ERA	Output	Data Terminal Ready A (+)
	5	SG	-	Signal Ground	SG	-	Signal Ground
	6	VCC *1	-	+5V±5% output 0.25A	CSB	Input	Send Possible B (-)
	7	RDB	Input	Receive Data B (-)	SDB	Output	Send Data B (-)
	8	SDB	Output	Send Data B (-)	CSA	Input	Send possible A (+)
	9	TRMTX	-	Termination (Receiver side: 100Ω)	ERB	Output	Data Terminal Ready B (-)
	Shell	FG	-	Frame Ground (Common with SG)	FG	-	Frame Ground (Common with SG)

\*1: RI and VICC of Pin 9 are switched on the software.

VCC Output is not protected from overcurrent.

Please follow the current rating to avoid false operation or breakdown.



### 4.3 Cable Diagram at the time of replacement

#### ◆GP-3400T's COM1 cable

It can be used for the COM1 or COM2 on SP-5B10(Power box) as it is.

For RS-232C connection, it can be used for the COM1 on SP-5B00(Standard Box) as it is.

When a RS-422/485 device is connected via the COM1 port, if GP-3400T is replaced with SP-5B00(Standard box), it will be connected via the COM2 port of SP-5B00(Standard box). (The cable diagram can be still used.)

Before SP-5B00(Standard box) is connected, be sure to change the port setting to COM2 on the Device/PLC setting.

Also, please check the communication settings with GP-Pro EX Device/PLC Connection Manual just in case.

(<http://www.pro-face.com/otasuke/files/manual/gpproex/new/device/index.htm>)

#### ◆GP-3400T's COM2 cable

For the following case only, it can be used for the COM1/COM2 on SP-5B10 (Power box), COM2 on SP-5B00(Standard box) if the "[COM Port Conversion Adapter \(CA3-ADPCOM-01\)](#)" is added to the GP's side.

When an online adapter (CA4-ADPONL-01) is attached to the GP- 3400T's cable, detach it.

- RS-422 cable (CA3-CBL422-01)
- 2-port adapter cable (CA3-MDCB11) +2-port adapter II (GP070-MD11)
- Multi-link cable (CA3-CBLMLT-01 (5m) )
- Connector terminal conversion adapter (CA3-ADPTRM-01) +RS-422 cable (homemade cable)
- MPI cable (GP3000-MPI21-PFE)
- SIEMENS COM port conversion adapter (CA3-ADPSEI-01) +CA3-MPI-PGN-PFE or CA3-MPI-PG1-PFE

In all other cases, the operation is not guaranteed and it's recommended to prepare a new connection cable. To check the cable diagram, please refer to GP-Pro EX Device/PLC Connection Manual.

(<http://www.proface.com/otasuke/files/manual/gpproex/new/device/index.htm>)

### 4.4 Multilink Connection

For the communication drivers that support serial multi-link, see [Which drivers support serial multilink communication?]

([http://www.pro-face.com/otasuke/files/manual/gpproex/new/device/com\\_mlnk.htm](http://www.pro-face.com/otasuke/files/manual/gpproex/new/device/com_mlnk.htm)).

## Chapter 5 Appendix

### 5.1 Changing the setting of the external media to use

If a CF card is used for GP-3400T, after the display unit type of the project file is changed to SP5000 series, "a CF card" is automatically replaced with "a SD card" for the external media setting.

(1) To use a USB flash drive instead of a SD card -> [Solution 1](#)

(2) To check or change the SD card's data output destination folder setting  
-> [Solution 2](#)


#### [Solution]

1. Change the SD Card setting to the USB storage setting following the steps below.


<Procedure>

i. Click [Project]->[Information]->[Destination Folder].

ii. Uncheck "Enable SD Card" and check "Enable USB Storage."

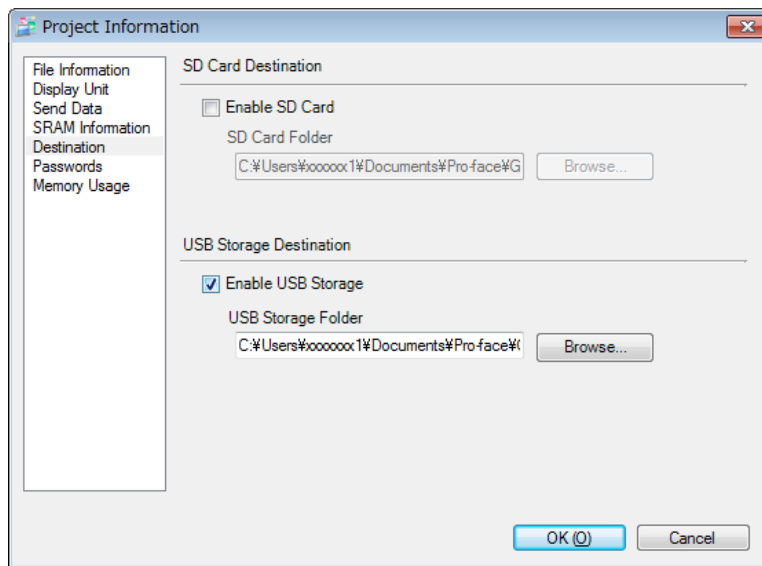

iii. Click the [Browse] button and specify a destination folder.

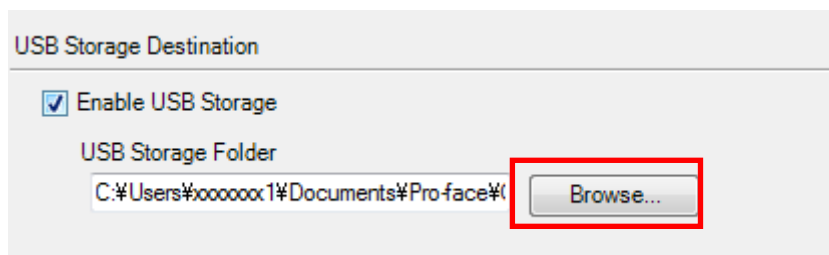


- iv. Click [OK] to confirm the setting.
- v. Click [Project]->[Save] to save changes.
- vi. Check each function that uses the CF card and replace the setting of [SD Card] with the one of [USB Storage].

#### NOTE

To check each function setting of GP-Pro EX, refer to GP-Pro EX Reference Manual.

- 2. Check and change the destination folder setting following the steps below.
  - i. Click [Project]->[Information]->[Destination Folder].
  - ii. The current setting is displayed.

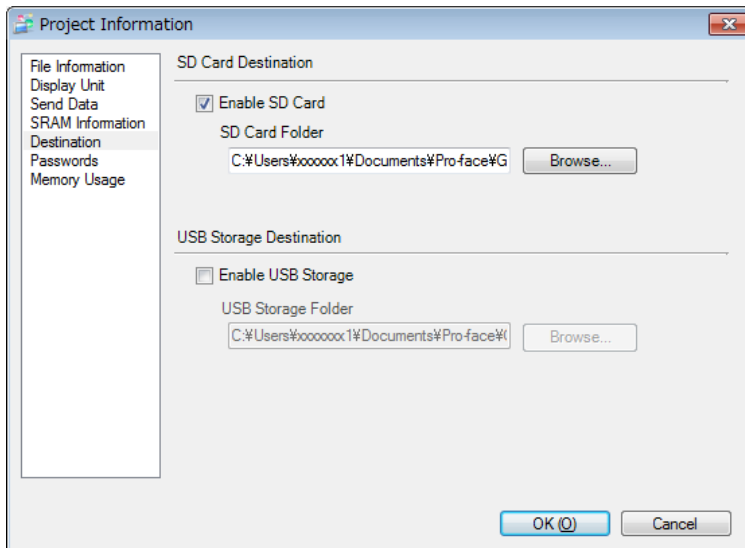

- iii. After changing it, click [OK] to confirm the setting.
- iv. Click [Project]->[Save] to save changes.